

AcuPanel-EASI-48

48 Channel Subpanel

QUICK SETUP GUIDE

ACUPANEL

EASI



IMPORTANT SAFETY NOTICE

Read this document and the following symbols carefully before the installation, operation and maintenance of the AcuPanel-EASI-48.

Accuenergy is not responsible or liable for any damages or injuries caused by improper meter installation and/or operation.

- Prior to maintenance and repair, the equipment must be de-energized and grounded.
- A switch or circuit breaker must be included in close proximity to the equipment and operator.
- All maintenance work must be performed by qualified professionals with formal training and experience in high voltage/current.

The following symbols can be found either in this document or on the product.

**ELECTRIC HAZARD:** Indicates information about procedures which must be followed to reduce the risk of electric shock and danger to personal health.

**NOTE:** Provides additional information before an action shall be taken by the user.

LEGAL NOTICE

This AcuPanel-EASI-48 quick setup guide provides informational and operational guidance regarding the use of the panel. While effort has been made to ensure the accuracy, reliability, and completeness of the information at the time of publication, Accuenergy assumes no responsibility for any errors, omissions, or misunderstandings in this document and reserves the right to modify its content at any time without prior notice.


Users should verify with Accuenergy or their authorized local representative that the document in use is the latest version and strictly adhere to the installation, operation, and maintenance procedures specified herein. Accuenergy shall not be held liable for any damages or consequences resulting from improper use or failure to comply with the provisions of this document. This quick setup guide may not be altered or reproduced in whole or in part by any means without the expressed written consent of Accuenergy.

PACKAGE CONTENTS

**NOTE**


Carefully open the packaging of the panel and do not use excessive force. Inspect all the contents of the package are not damaged before installing the panel.

- A AcuPanel-EASI-48 Subpanel
- B Two AcuRev 4100 Submeters
- C Four Wall Mounting Hardware and Screws
- D Screwdriver
- E AK-03 Kit Includes Three Inline Fuses
- F Angled Slim Patch Ethernet Cable
- G Quick Setup Guide (Not Pictured)

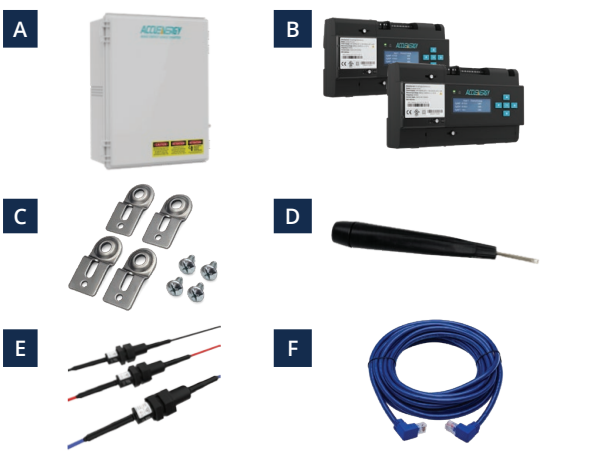

SUBPANEL INTERNAL COMPONENTS

- 1 AcuRev 4100 Submeter Power Supply Terminals
- 2 Wiring Configuration Document
- 3 48 CT Terminals
- 4 Dual Ethernet Ports
- 5 Pre-Wired AcuRev 4100 Submeters
- 6 RS485 Terminal
- 7 Voltage Terminals
- 8 Ground Terminal
- 9 NEMA 4X Enclosure

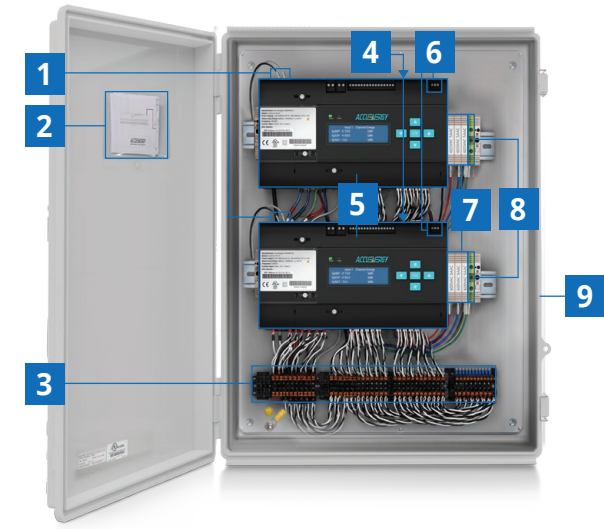


INSTALLATION STEPS

- Installation of a subpanel involves hazardous voltages. The process must be performed by a qualified or licensed electrician.
- Before commencing the wiring or service of the subpanel, ensure to de-energize and lock out all the circuits.
- Short the secondary of the CT before disconnecting. Do not leave the secondary of the CT open on an energized conductor.
- Ensure the polarity of the CT aligns with the connected phase correctly.
- To reduce the risk of electric shock, always open or disconnect the circuit from the building power distribution system before installing or servicing current transformers.
- Verify the service is fully disconnected before making any voltage connections. Connect the common ground point of the AcuPanel-EASI-48 to the facility grounding system. Ensure proper protective earthing and compliance with electrical safety standards.



To commission the AcuPanel-EASI-48 at the installation location, follow the steps provided.

1. To surface mount the AcuPanel-EASI-48 vertically, align the four wall mount lugs with the corner mounting holes at the rear of the subpanel enclosure. Secure the lugs to the enclosure with the four provided mounting screws provided. Mount the enclosure to the wall using four screws suitable for the wall material. Allow sufficient clearance for conduit and panel door swing.
2. Install conduit between the distribution panel and the AcuPanel-EASI-48. Route voltage leads, CT secondary cables, and communication wires through the conduit. Ensure that all wire sizes comply with local electrical codes.
3. Install the inline fuses on the A, B, and C leads for overcurrent protection. Connect voltage reference leads A, B, and C to the corresponding voltage terminals in the AcuPanel-EASI-48. Secure the N lead to the neutral bus in the distribution panel to ensure reliable return path and accurate voltage measurements.
4. Install Accuenergy split-core CTs or Rogowski coils on the feeder lines in the distribution panel, ensuring the polarity arrow or H1 label faces the source. Refer to the figure for various connection configurations to the AcuPanel-EASI-48. Connect secondary leads to the designated push in current terminals. Verify the polarity of the CT connections to avoid inaccurate readings.
5. To set up communication with the two AcuRev 4100 meter, use the RS485 ports or the dual Ethernet ports. For RS485, connect the A+, B-, and S terminals to an RS485-to-USB adapter, then connect to a PC. For Ethernet, connect the RJ45 port to an Ethernet cable to enable cloud-based communication or daisy-chaining.

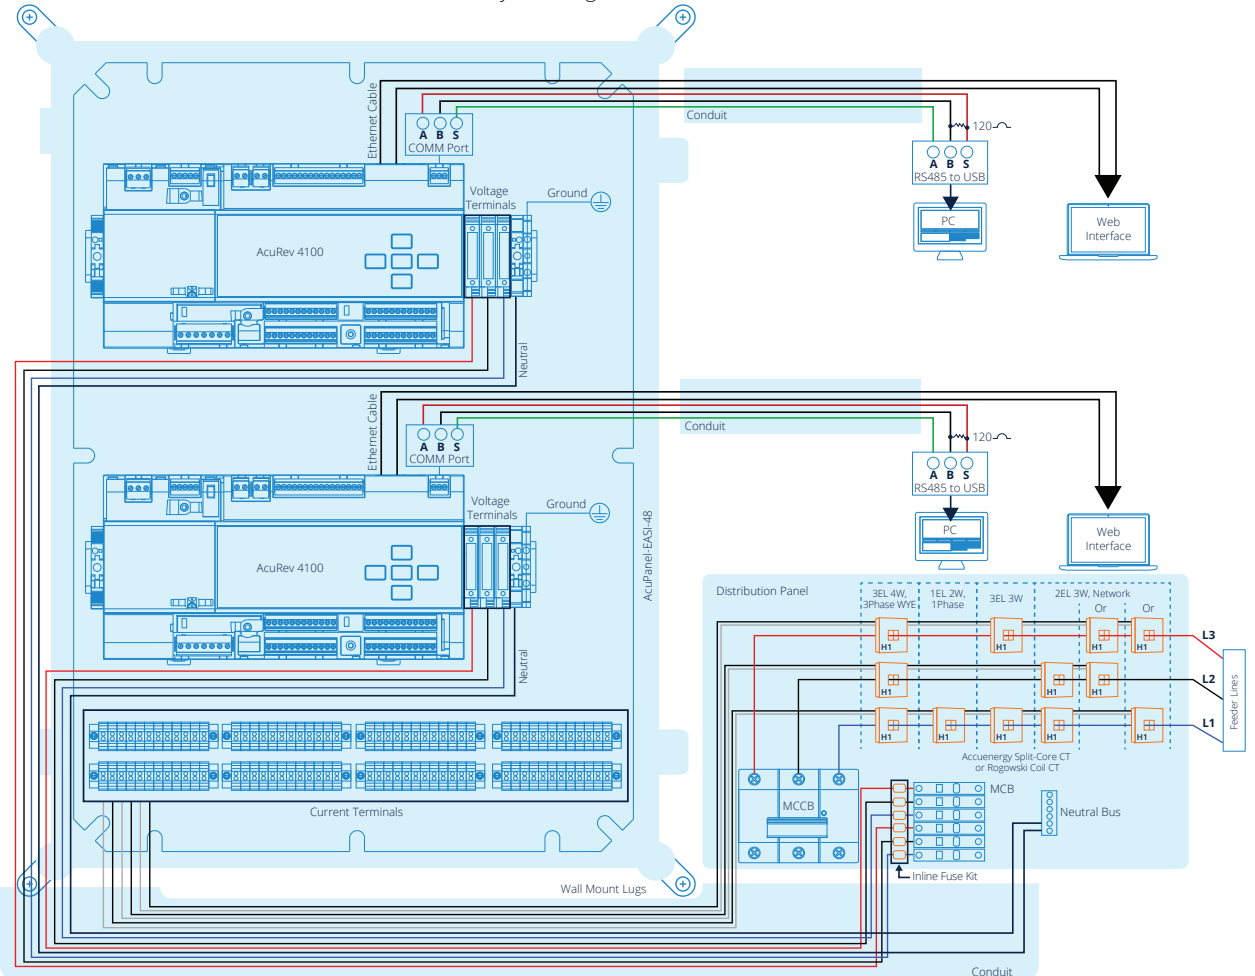

ACUPANEL
EASI

ENERGY | ALLOCATION | SYSTEM | INFORMATION

Choose the EASI Path to Energy Solutions

For more information, please refer to the AcuPanel-EASI-48 Installation Guide.

easi.accuenergy.com/easi-48-install-guide

Contact fieldservices@accuenergy.com or codehelp@accuenergy.com
for any additional queries.



ACCUEVERGY

Accuenergy Inc.

Los Angeles - Toronto - Pretoria

North America Toll Free: 1-877-721-8908

Web: www.accuenergy.com

Email: marketing@accuenergy.com

Revision Date: July 2026 Version: 1.0.0
Specs Subject To Change Without Notice.